

**PROFORMA FOR SAFE DRINKING WATER AND SANITARY
CONDITION CERTIFICATE**

No. 197/26Dated: 27/05/26

It is certified that an inspection team headed by Mr. Ratnesh Badole
(Name of Officers with designation) from PHED Indore Division - 2

PHED inspected the **J K INTERNATIONAL SCHOOL, 720-7455, PREMIUM PARK, INDORE, DIST.- INDORE, MP** on
15/05/2026 and on the basis of Water Test Report (Attached) bearing no. AB/OSD/02/2026-27/
dated 28-05-26 of PHED Indore Division - 2 418

(PHED Lab) certified that the **J K INTERNATIONAL SCHOOL, 720-7455, PREMIUM PARK, INDORE, DIST.- INDORE, MP** has safe drinking water facilities for the students and members of staff of the institution. School is also maintains the hygienic sanitation condition in the school building & the campus as per norms prescribed by the Central/ State/ U.T. Govt.

This certificate is valid till 6 month

Ratnesh
Chemist

District Water Testing Laboratory
P.H.E.D. Indore (M.P.)

Signature with seal

:-

Ratnesh
Assistant Engineer

Public Health Engineering

Name

:-

Ratnesh
Mr. Ratnesh Badole

Designation

:-

Assistant engineer

Name & address of the office/Department: -

PHED sub Dn. Indore

To,

J K INTERNATIONAL SCHOOL, 720-7455, मंदरलैंड इंग्लिश स्कूल शिक्षा समिति, इन्दौर
PREMIUM PARK, INDORE, DIST.- INDORE, MP
(Name and address of the institution)

Ratnesh
Ratnesh

PRINCIPAL

**J. K. INTERNATIONAL SCHOOL
INDORE (M.P.)**

Note: The certificate is to be issued by authorized officer / PHED Lab/local bodies

TEST REPORT

Report No. AB/OSD/02/2026-27/418

Name of Client and Address: M/s. JK INTERNATIONAL SCHOOL PREMIUM PARK, INDORE	Sample Code	AB/OSD/02/2026-27/418
	Sample Location	Drinking Water
	Sample Collected By	self
	Method of Sampling	IS:3025 (Part 1)
	Sample Type	Drinking Water
	Sample Collected On	15.05.2026
	Sample Received on Date	15.05.2026
	Analysis Date	15.05.2026 to 25.05.2026
	Reporting Date	25.05.2026
Sample returned /stored	Stored at 4 C for 5 days from the date of reporting	

TEST PARAMETERS

Sr. No.	Parameter	Result	Limit as per IS:10500	Unit	Standard Method
1	Colour	1.0	<5	Hazen Units	IS:3025 Part-04 (R.A:2002)
2	Odour	Agreeable	Agreeable	--	IS:3025 Part-05 (R.A:2002)
2	Turbidity	0.37	<1.0	NTU	IS:3025 Part-10 (R.A:2002)
3	TDS	67.0	<500	Mg/Lit	IS:3025 Part-16 (R.A:2002)
Chemical Parameters					
1	pH	7.45	6.5 to 8.5	--	IS:3025 Part-11(R.A:2002)
2	Total Hardness as CaCO ₃	59.12	<200	mg/lit	IS:3025 Part-21(2009)
3	Total Alkalinity as CaCO ₃	42.46	<200	mg/lit	IS:3025 Part-23 (R.A:2003)
4	Chloride as Cl	14.82	<250	mg/lit	IS:3025 Part-32 (R.A:2003)
5	Sulphate as SO ₄	4.12	<200	mg/lit	APHA:22 ND edition-(4500-SO ₄ E)
6	Residual Chlorine	BDL	0.2	mg/lit	APHA:22 ND edition-(4500-Cl B)
7	Sulphides as S	BDL	<0.05	mg/lit	IS:3025 (Part 29)
8	Ammonia	BDL	<0.5	mg/lit	APHA:22 ND edition-(3500-Cr B)
9	Nitrate as NO ₃	1.0	<45.0	mg/lit	APHA:22 ND edition- (4500-F F)
10	Fluorides as F	0.24	<1.0	mg/lit	APHA: 22 ND edition-(4500-F F)
11	Phenol	BDL	<0.001	mg/lit	IS: 3025 Part-43(R.A: 2003)
12	Detergent	BDL	<0.2	mg/lit	APHA: 22 nd edition -(5540 C)
Elemental Parameters					
1	Calcium as Ca	21.12	<75.0	mg/lit	IS:3025 Part-02(2004)
2	Cadmium as Cd	BDL	<0.003	mg/lit	IS:3025 Part-02(2004)
3	Manganese as Mn	0.02	<0.1	mg/lit	IS:3025 Part -02(2004)
4	Iron as Fe	<0.1	<0.30	mg/lit	IS:3025 Part-02(2004)
5	Magnesium as Mg	4.45	<30.0	mg/lit	IS:3025 Part-02(2004)
6	Mercury as Hg	BDL	<0.001	mg/lit	IS:3025 Part-02(2004)
7	Selenium as Se	BDL	<0.01	mg/lit	IS:3025 Part-02(2004)
8	Zinc as Zn	0.32	<5	mg/lit	IS:3025 Part-02(2004)
9	Arsenic as As	BDL	<0.01	mg/lit	IS:3025 Part-02(2004)
10	Lead as Pb	BDL	<0.01	mg/lit	IS:3025 Part-02(2004)
11	Chromium as Cr	BDL	<0.03	mg/lit	IS:3025 Part-02(2004)
12	Aluminum as Al	0.32	<0.03	mg/lit	IS:3025 Part-02(2004)
13	Copper as Cu	<0.02	<0.05	mg/lit	IS:3025 Part-02(2004)
14	Boron as B	0.02	<0.5	mg/lit	IS:3025 Part-02(2004)

प्रतिव

मदरलैंड इंग्लिश स्कूल शिक्षा समिति, इन्दौर

1 of 1

PRINCIPAL

J. K. INTERNATIONAL SCHOOL


INDORE (M.P.)


- The test report shall not be reproduced, except in full, without written approval of the company.
- Results relate only to the parameters tested.
- No Repeat Analysis will be entertained after 15 days from the date of sampling.

15	Barium as Ba	0.003	<0.7	mg/lit	IS:3025 Part-02(2004)
16	Silver as Ag	BDL	<0.1	mg/lit	IS:3025 Part-02(2004)
17	Molybdenum as Mo	BDL	<0.07	mg/lit	IS:3025 Part-02(2004)
18	Nickel as Ni	<0.01	<0.02	mg/lit	IS:3025 Part-02(2004)

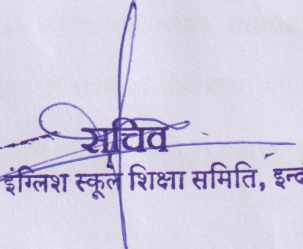
Microbiological Parameters					
1	Total Coliform	<2	Absent	MPN/100ml	IS: 1622 (R.A :1996)
2	Escherichia coli	<2	Absent	MPN/100ml	IS: 1622 (R.A :1996)


- BDL – Below Detectable Limit
- Note: For E-Coli and Coliform <2 can be considered as absent


 Chemist
 District Water Testing Laboratory
 P.H.E DEPT. Indore (M.P.)


 Assistant Engineer
 District Health Engineering
 District Water Testing Laboratory
 P.H.E DEPT. Indore

1 of 2


 मद्रलाल
 मदरलाल इंग्लिश स्कूल शिक्षा समिति, इन्दौर


 PRINCIPAL
 J. K. INTERNATIONAL SCHOOL
 INDORE (M.P.)

- The test report shall not be reproduced, except in full, without written approval of the company.
- Results relate only to the parameters tested.
- No Repeat Analysis will be entertained after 15 days from the date of sampling.